


016-A-GTP ONE LINE DIAGRAM

GENERAL NOTES

- GENERAL NOTES: UNLESS OTHERWISE SPECIFIED.
- 1.) THE CONNECTION DIAGRAM SHOWN ON THIS SHEET IS A RECOMMENDATION ONLY. THE FINAL SYSTEM CONFIGURATION SHALL BE DETERMINED BY THE ELECTRICIAN INSTALLING THE SOLAR POWER SYSTEM.
 - 2.) ALL WIRING NOT PROVIDED WITH THE PRE-ASSEMBLED SOLAR SYSTEM AND ANY UNLABELED WIRES SHOWN IN THIS PLAN SET WILL BE DETERMINED BY ELECTRICIAN AT FINAL SITE.
 - 3.) ALL WIRING AND MATERIALS REQUIRED TO INTERCONNECT ITEMS PROVIDED BY SOLARSET SHALL BE SUPPLIED AND INSTALLED BY THE END USER OR THEIR CONTRACTOR (OTHERS).
 - 4.) GROUNDING AND BONDING IS SHOWN FOR REFERENCE ONLY. GROUNDING AND BONDING REQUIREMENTS WILL BE DETERMINED ON-SITE AND ARE THE RESPONSIBILITY OF THE ELECTRICIAN INSTALLING THE SOLAR POWER SYSTEM.
 - 5.) ALL SOLAR MODULE FRAMES ARE BONDED USING ILSCO SGB-4 SOLAR BOND CLAMPS AND A CONTINUOUS 8 AWG BARE SOLID COPPER WIRE. A LOOSE COIL OF WIRE, EIGHT FEET IN LENGTH, IS PROVIDED AFTER THE LAST SOLAR MODULE BOND CLAMP. IT IS THE RESPONSIBILITY OF THE ELECTRICIAN INSTALLING THE SOLAR POWER SYSTEM TO CONNECT THE SOLAR MODULE BONDING WIRE TO A GROUND ROD. ALL BONDING CLAMPS ARE INSTALLED ON CLEAN BARE METAL USING OX-GARD ANTI-OXIDANT COMPOUND (DEL CITY PART NUMBER 964DL).
 - 6.) ALL WIRE SIZES ASSUME A MAXIMUM LENGTH OF 100 FEET OR LESS.

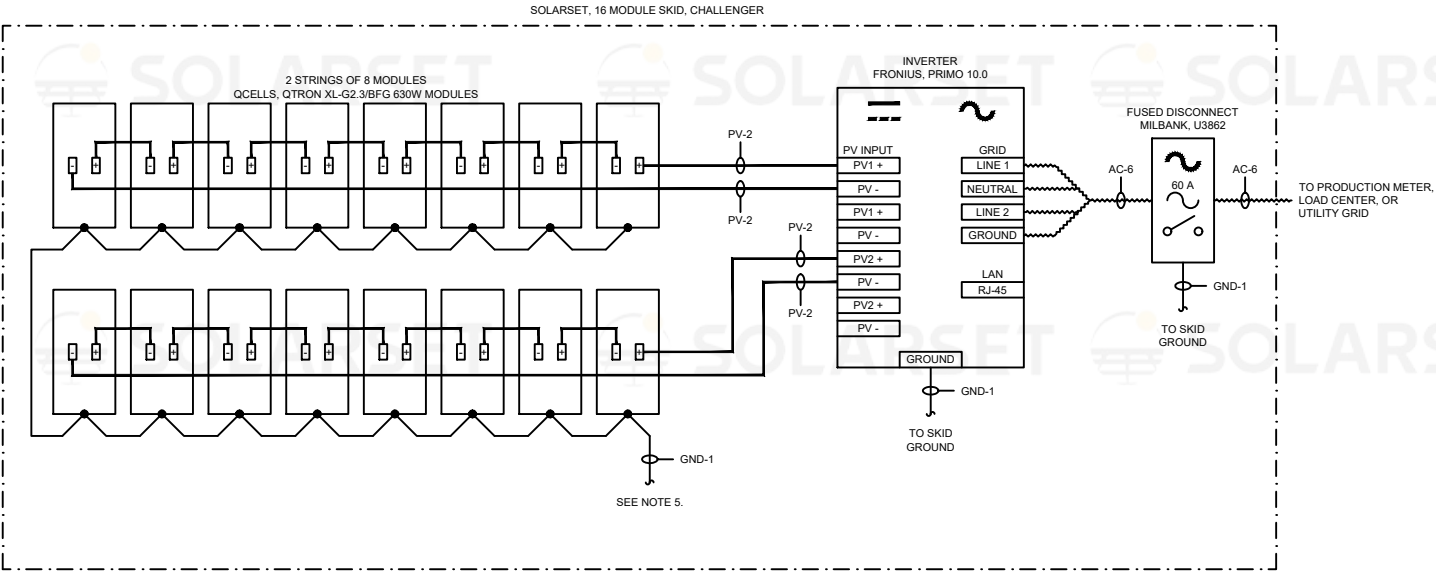

PROPRIETARY AND CONFIDENTIAL -- THE INFORMATION CONTAINED IN THIS DRAWING IS THE SOLE PROPERTY OF SOLARSET. ANY REPRODUCTION IN PART OR AS A WHOLE WITHOUT THE WRITTEN PERMISSION OF SOLARSET IS PROHIBITED.

DRAWING TITLE		GRID TIE SOLAR SYSTEM 016A-GTP ONE LINE DIAGRAM													
WORK ORDER		81XXX													
CUSTOMER		48920 County Road E Center, CO 81255													
DRAWING NUMBER		719-754-5100													
REV		DATE		DESCRIPTION		ID		REV		DATE		DESCRIPTION		ID	
1		4 SEPTEMBER 2028		NEW DRAWING		GSF		7							